



Model 103


Listed Dimensions:
56" L x 42" W x 30" H

Front View



Top View

Suggested concrete pad 62" x 48"

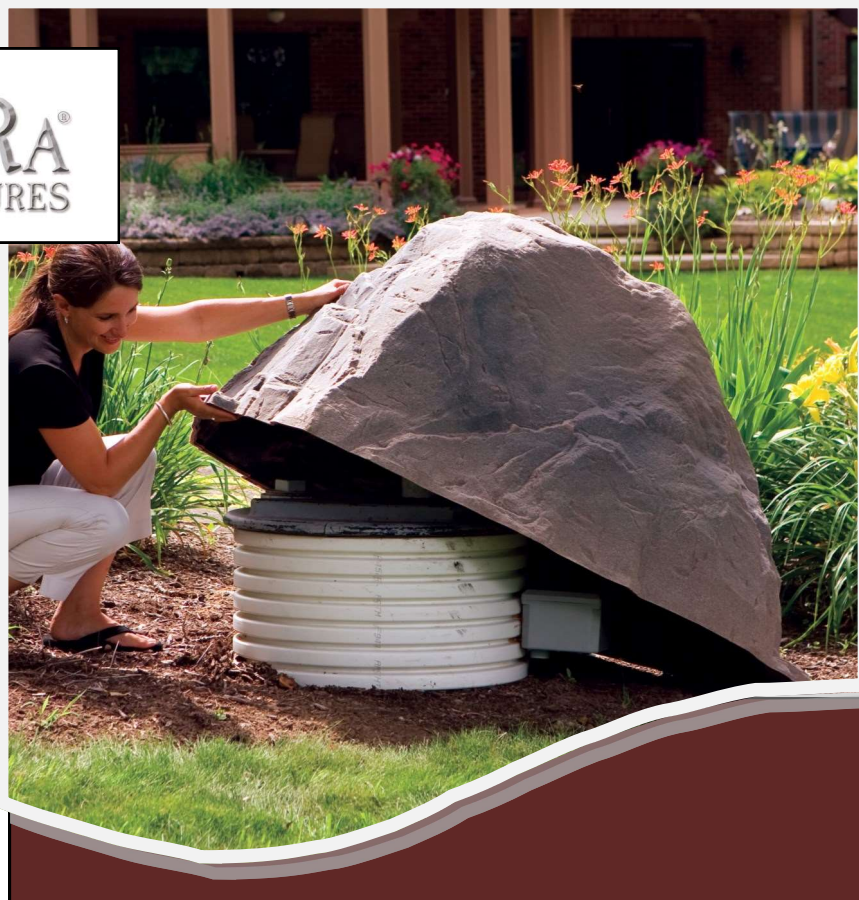

IDEAL CONCEALING APPLICATIONS:

- Septic Manhole up to 36" in Diameter
- Backflow Assemblies 2" in Diameter
- Pumping System Assemblies and Components
- Constant Pressure Well Equipment and Tanks

Sample Interior Spacing

Height	Length	Width
4"	45"	26"
12"	40"	18"
24"	20"	10"

Diameter Sizing

Height	Diameter
4"	26" Dia
12"	32" Dia
24"	15" Dia

Insulation Pouch



Concrete Anchors



Heat Cables

Ventilation



DekorRa Rocks do taper in length and width as height increases. Any concerns in sizing for a specific item can be discussed with a DekorRa Customer Service Rep at 888-635-8585, sizeofrock@dekorraproducts.com along with a photo of the specific application and dimensions.


6" Plastic
Stakes
included




DekoRRa Products

888-635-8585

www.dekorraproducts.com

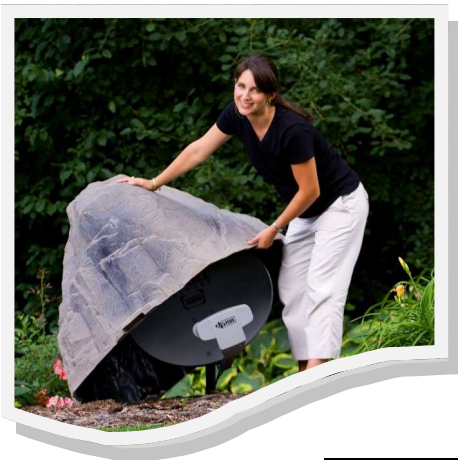

DEKORRA ROCK COLOR OPTIONS:

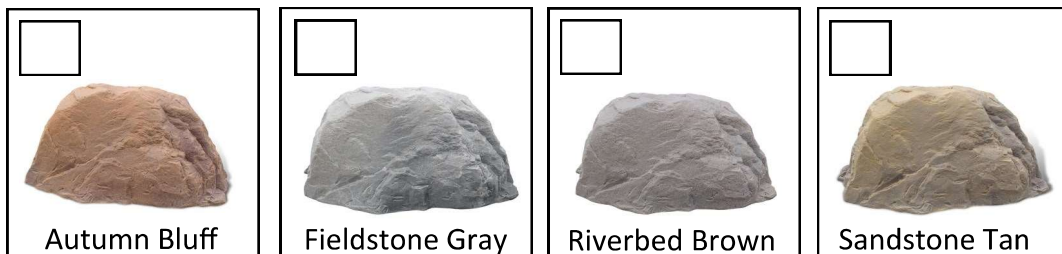

ASSE STANDARD 1060 CLASSIFICATION



- **Class I** Freeze protection. DekoRRa Rock Enclosures Class I and I-V shall have a minimum thermal resistance value of R-8 and a positive means of heat. DekoRRa Rock Enclosures have been designed and constructed to maintain a minimum internal temp. of 40°F.
- **Class II** Freeze retardant. DekoRRa Rock Enclosures Class II and II-V shall have a minimum thermal resistance value of R-8. DekoRRa Rock Enclosures have been designed and constructed to be installed in minimum external temperatures of 33°F.
- **Class III** Non Freeze protection. DekoRRa Rock Enclosures Class III and III-V are designed and constructed to provide system security for components when freezing temperatures are not a consideration.

INSTALLATION INSTRUCTIONS:

1. If Class I-V Heat required, installations will require GFI protected power mounted at least 6" above all water discharge ports per local code regulations.
2. Pour concrete pad per measurements provided or if mounting to ground, level area where enclosure is to be installed.
3. If installation requires self regulated heat tape, install per instructions securing to piping and valve. Place insulated pouch over valve and piping assembly.
4. Place rock over device. Verify that rock does not interfere with device. Insert included stakes for soil installation. For concrete installations see optional concrete installation instructions.

CONCRETE ANCHOR INSTALLATIONS

1. Drill hole with same diameter as anchor of sufficient depth. Clean drilled hole of dust and debris.
2. Place washer and nut onto threaded anchor as required.
3. With nut, washer and set pin in place insert anchor through rock flange column and into concrete base.
4. Using a proper size hammer set pin with several sharp and square strikes on head of pin until pin is flush with top of threaded anchor.

